


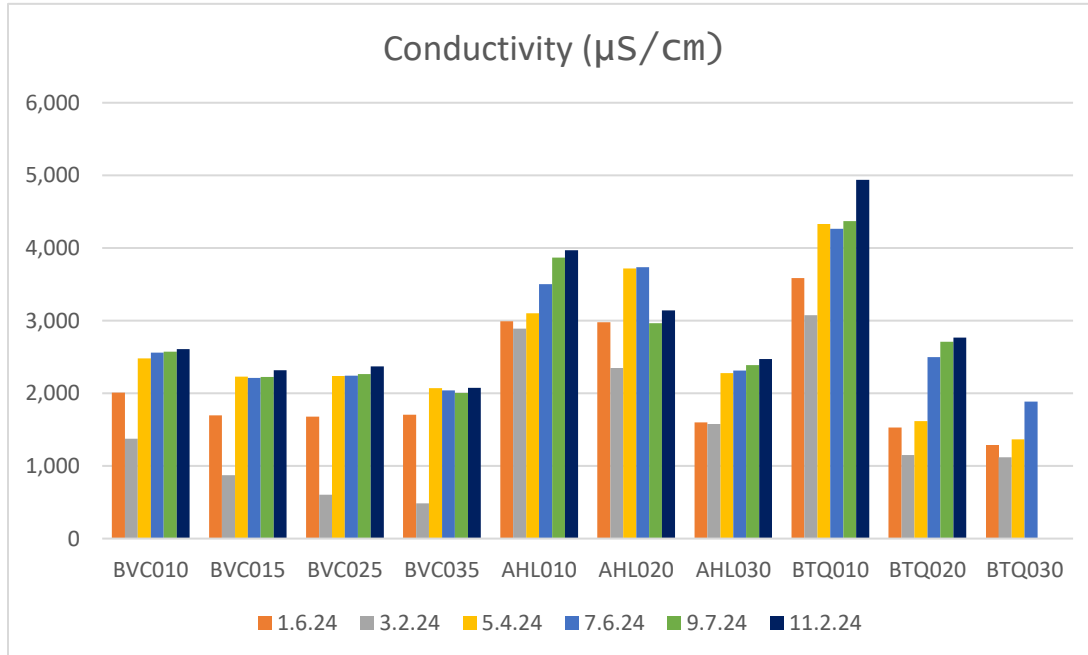
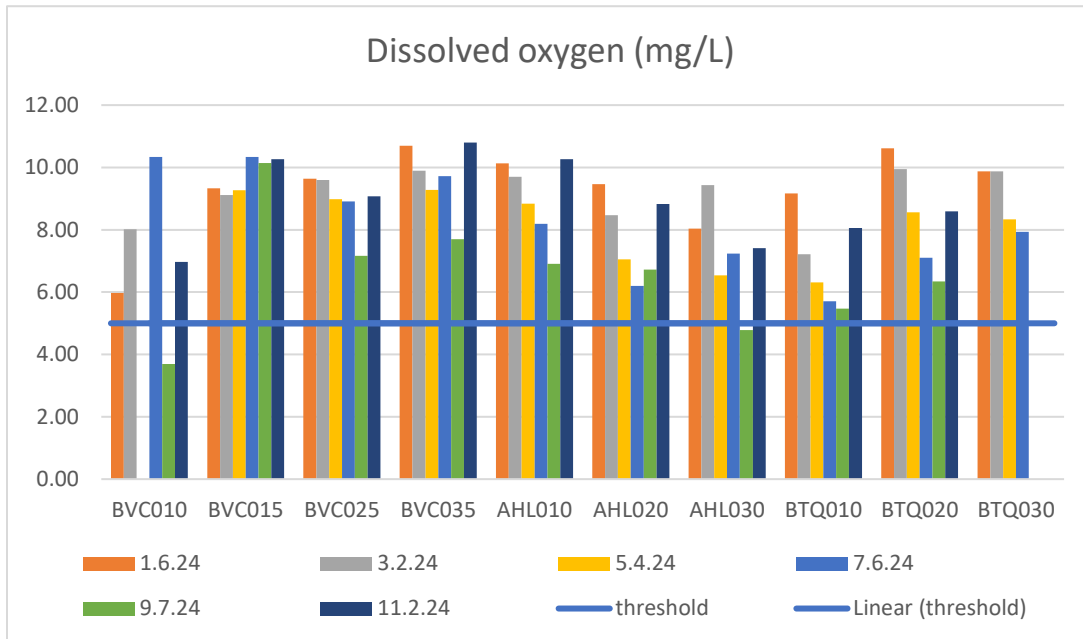
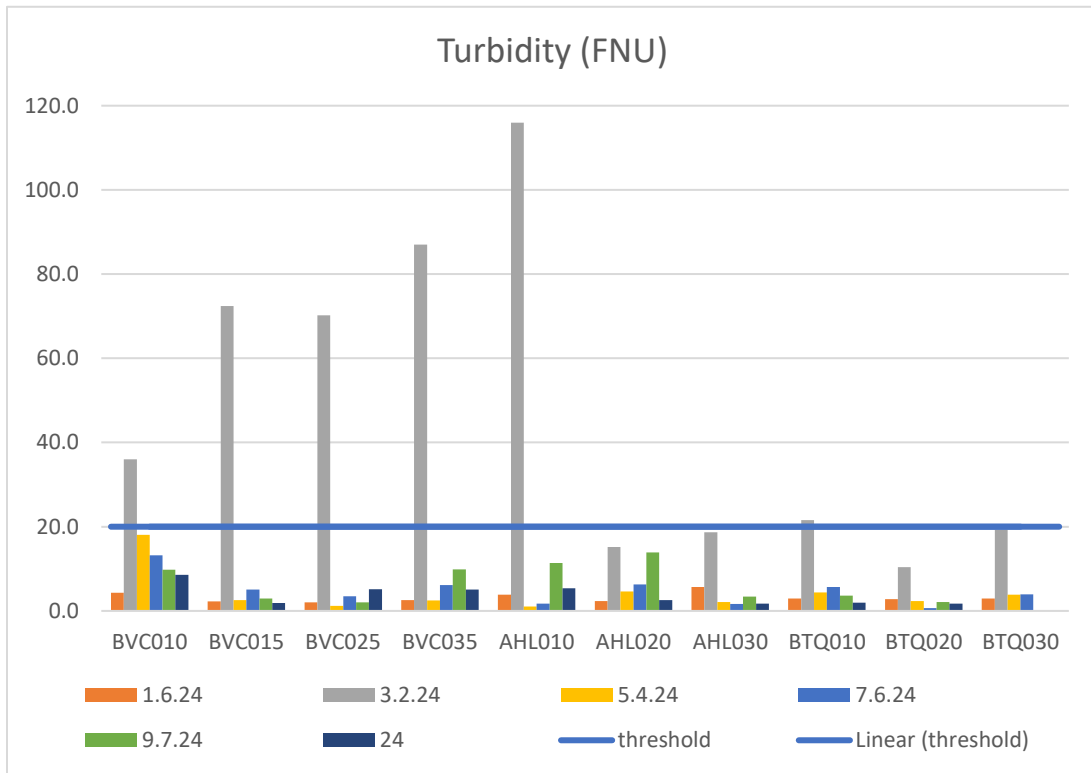




JANUARY – NOVEMBER 2024 WATER QUALITY RESULTS

Note: BTQ030 dry in September and November

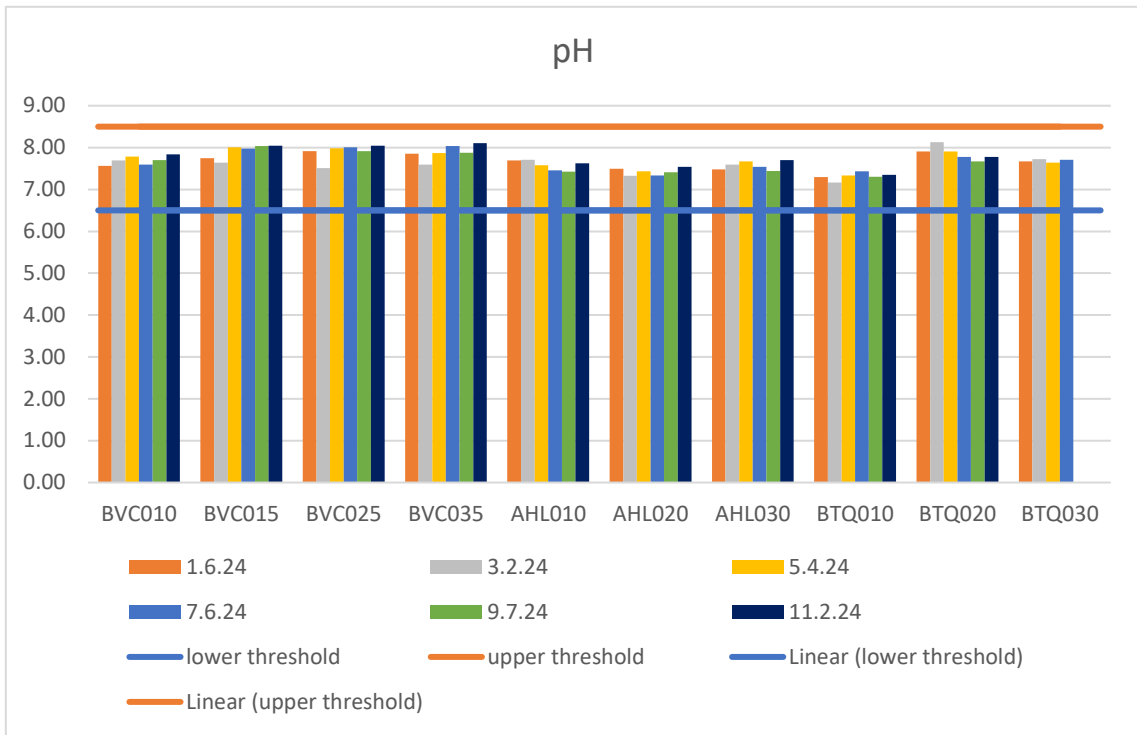

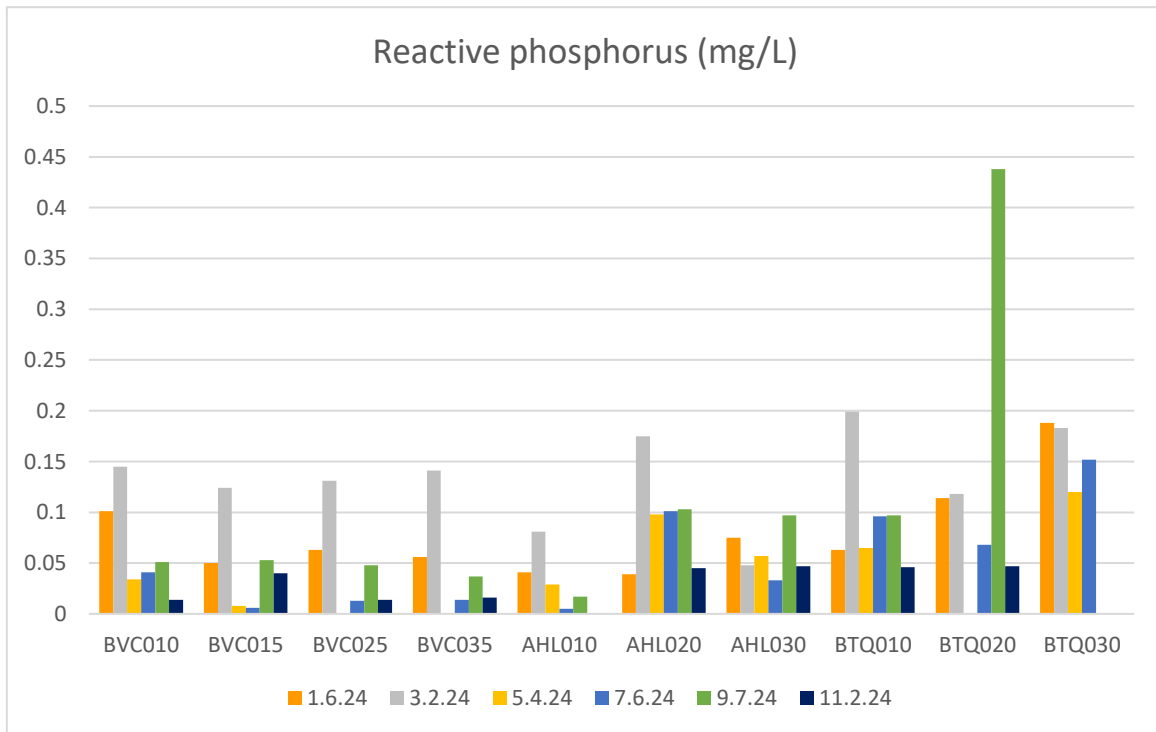

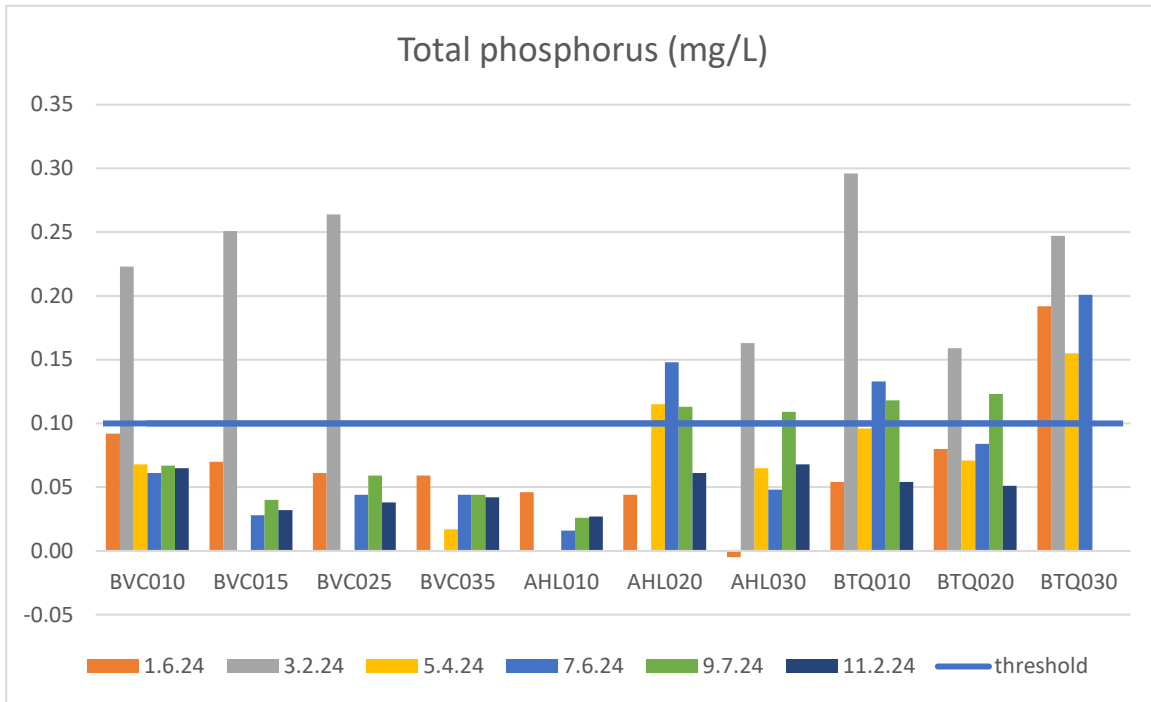

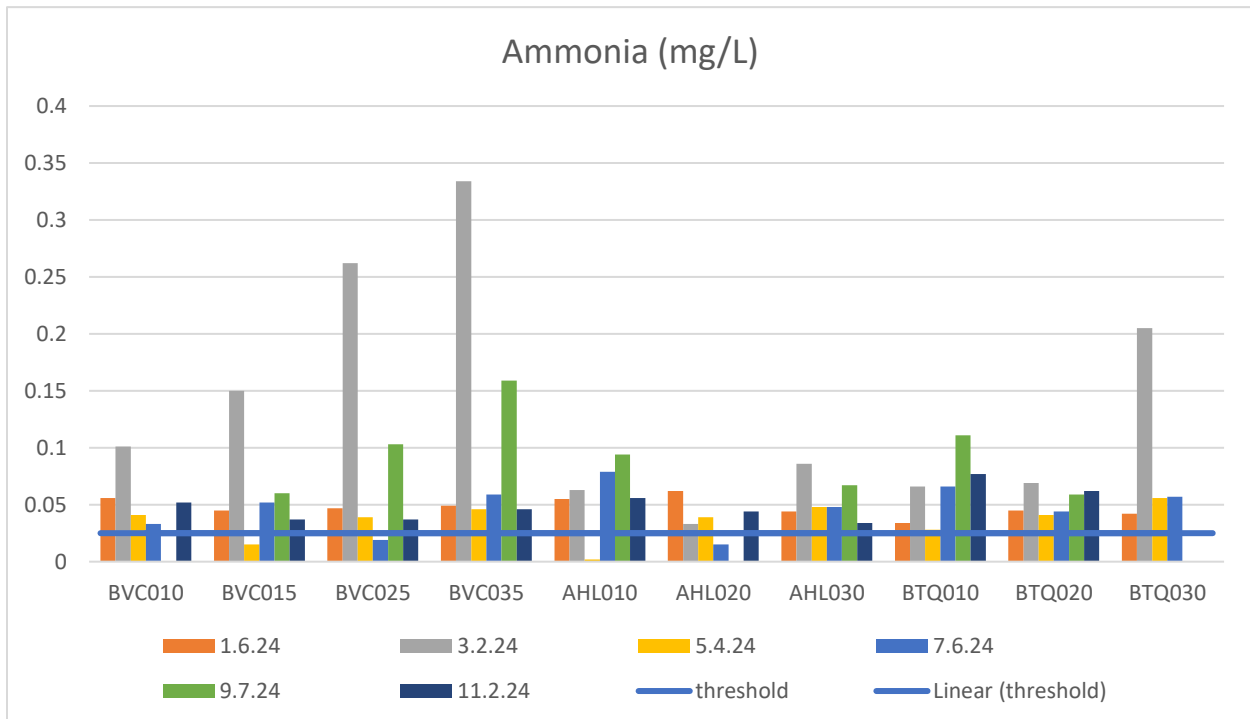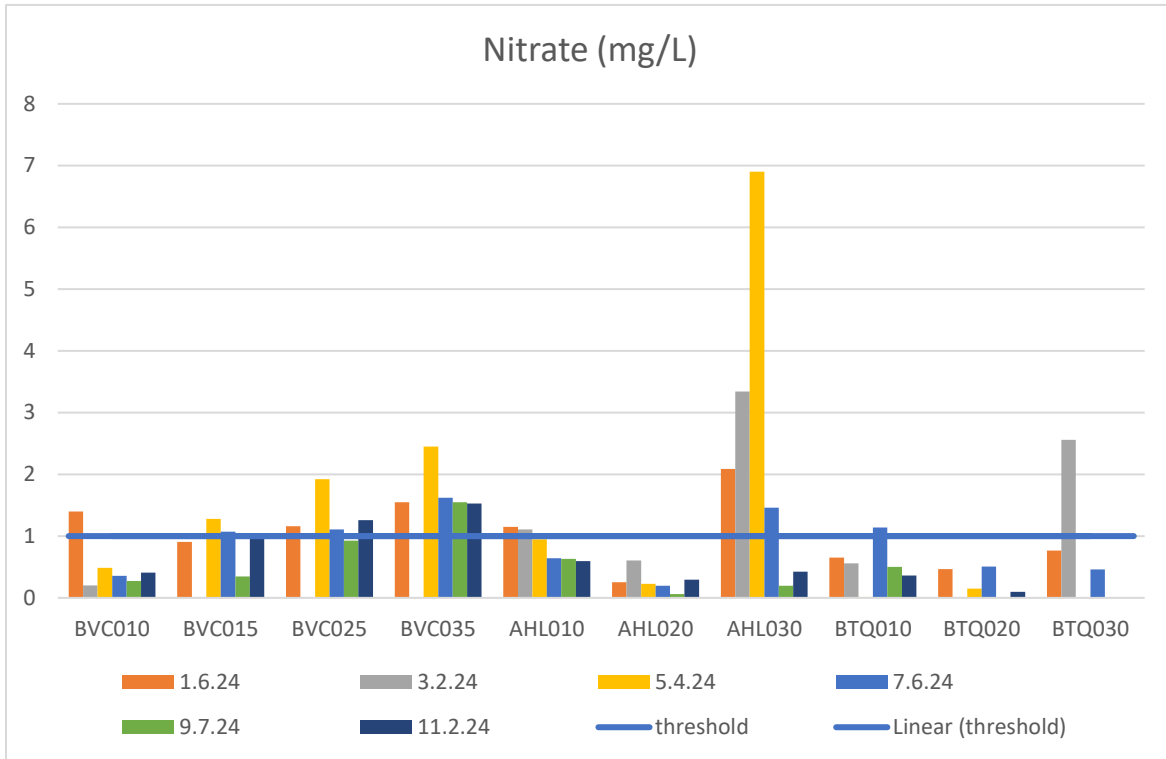

E. coli (MPN/100 mL)

